




**2013  
CA MECHANICAL CODE  
802.5.4 & 802.6**

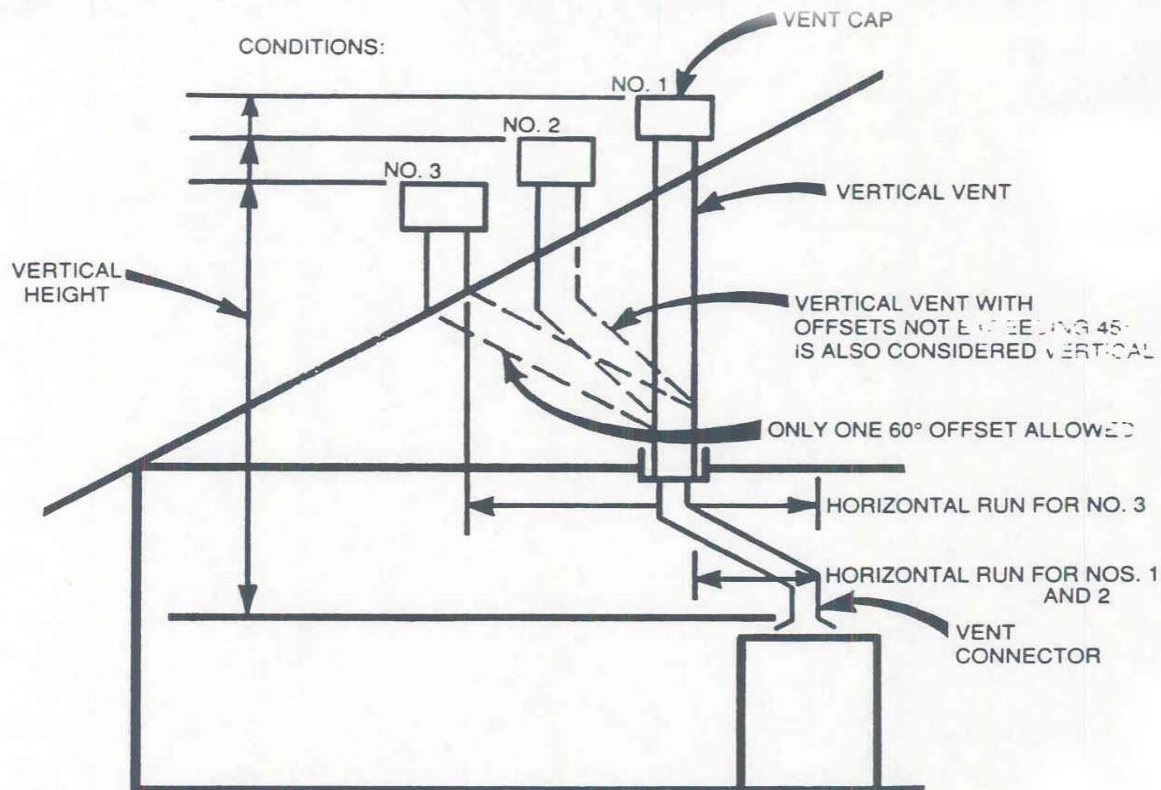

**VENT TERMINATION**

**806.1 General.** Type B, BW and L vents shall extend through the roof and terminate in listed vent caps.

**806.2 Gravity-type Venting Systems.** All venting systems except

- Type BW venting systems,
- Venting systems which are an integral part of a listed appliance and
- Mechanical draft systems regulated by Section 817

“shall terminate not less than 5 feet (1524 mm) above the highest vent collar which it serves.” This requirement includes all of the various kinds of venting systems regulated by this code except Type BW venting systems (Type B, Type L, factory-built chimneys, metal chimneys/smokestacks and masonry chimneys). See Section 806.3 for termination of Type BW vents.